CerTrust
dynamism, energetics, excellence

EU Type-Examination
Original
CERTIFICATE

**according to Directive 2013/29/EU Article 17(a)
of pyrotechnic articles**

Certificate No.: **PB 002532 001**

Test Report No.: **11002463 001** **Assessment Report No.: 11002463 001-A**

Manufacturer: **N2 GLOBAL MANUFACTURING SIA**
Kapsēdes iela 2, Liepāja, LV-3414, Latvia

Generic type: **Gas generator**

Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**

Registration number: **2806 – P1 – 002532**

Tested according to: EN 16263-1:2015; EN 16263-2:2015; EN 16263-3:2015; EN 16263-4:2015, EN 16263-5:2015

Identification of items:
(code by manufacturer)

N2G Type 0,5 **N2G Type 1,0** **N2G Type 1,5** **N2G Type 2,5** **N2G Type 5,0** **N2G Type 10,5**

CerTrust

This certificate refers to the above mentioned product. This is to certify that the test sample is in conformity with the Essential Safety Requirements of Annex I of the 2013/29/EU Directive. The manufacturer is entitled to use this certificate in connection with the EU Declaration of Conformity in accordance with the Directive. This certificate does not imply assessment of the series-production of the product and does not permit the use of a CerTrust mark of conformity.

ANNEX A – Detailed identification of articles

ANNEX B – Instruction for safe use, storage and disposal

Date of Issue:

Budapest, 11.09.2020
Version 03.

Notified Body 2806

Tasn§di G§bor

Digitally signed by Tasn§di G§bor
DN: cn=Tasn§di G§bor gn=G§bor c=HU l=Dunakeszi o=CerTrust Ltd. e=gabor.tasnadi@certrust.eu
Reason: I am the author of this document
Location:
Date: 2020-09-12 09:30+02:00

.....
Gábor Tasnádi

Annex A
for certificate of EU-type examination

Detailed identification of articles

Certificate No.: **PB 002532 001**

Test Report No.: **11002463 001**

Assessment Report No.: **11002463 001-A**

Generic type: **Gas generator**

Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**

Registration number: **2806 – P1 – 002532**

Manufacturer code .....: **N2G Type 0,5**

Name of product.....: **-**

Dimensions (mm)		Weight (g)		Sound level
Height :	205	NEC of initiator:	0,395	<120 dB AI MAX at 3 m
Width:	80	Fire-extinguishing tablet	500	
Length:	206	Gross mass:	4990	

Other information.....:

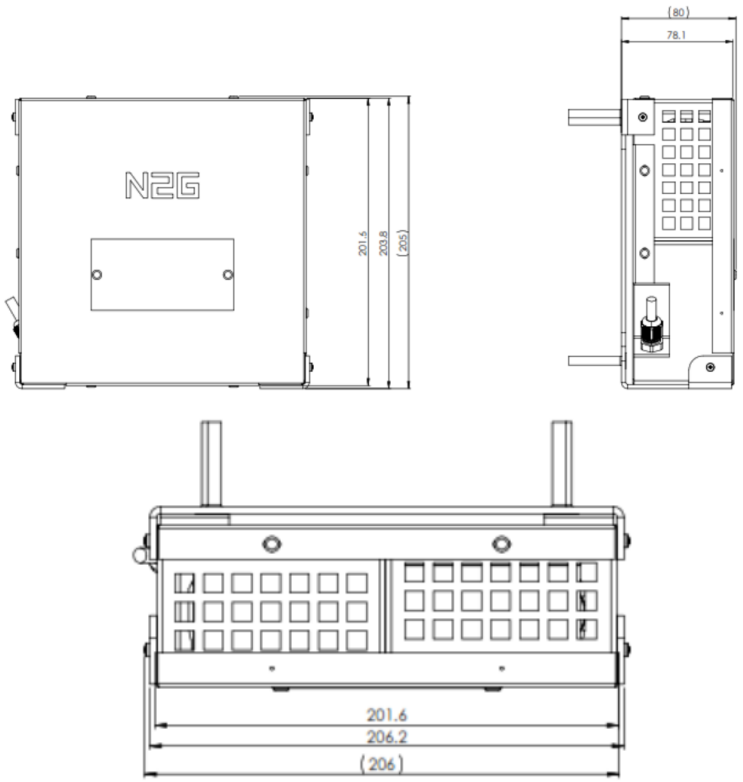

Annex A
for certificate of EU-type examination

Detailed identification of articles

Certificate No.: **PB 002532 001**

Test Report No.: **11002463 001** Assessment Report No.: **11002463 001-A**

Generic type: **Gas generator** Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**

Registration number: **2806 – P1 – 002532**

Manufacturer code .....: **N2G Type 1,0**

Name of product.....: **-**

Dimensions (mm)		Weight (g)		Sound level
Height :	205	NEC of initiator:	0,395	<120 dB AI MAX at 3 m
Width:	108	Fire-extinguishing tablet	1000	
Length:	211	Gross mass:	6750	

Other information.....:

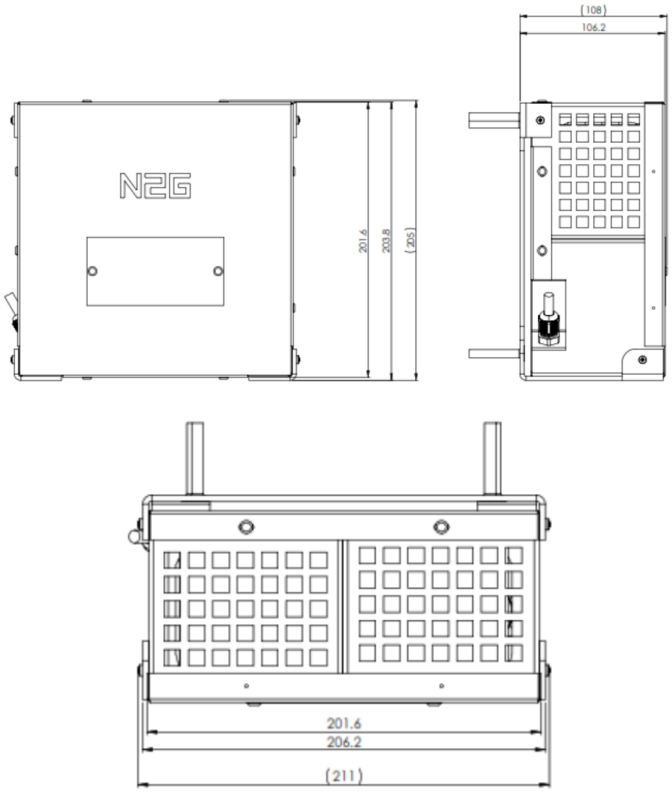

Annex A
for certificate of EU-type examination

Detailed identification of articles

Certificate No.: **PB 002532 001**

Test Report No.: **11002463 001**

Assessment Report No.: **11002463 001-A**

Generic type: **Gas generator**

Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**

Registration number: **2806 – P1 – 002532**

Manufacturer code .....: **N2G Type 1,5**

Name of product.....: **-**

Dimensions (mm)		Weight (g)		Sound level
Height :	205	NEC of initiator:	0,395	<120 dB AI MAX at 3 m
Width:	135	Fire-extinguishing tablet	1500	
Length:	211	Gross mass:	8100	

Other information.....:

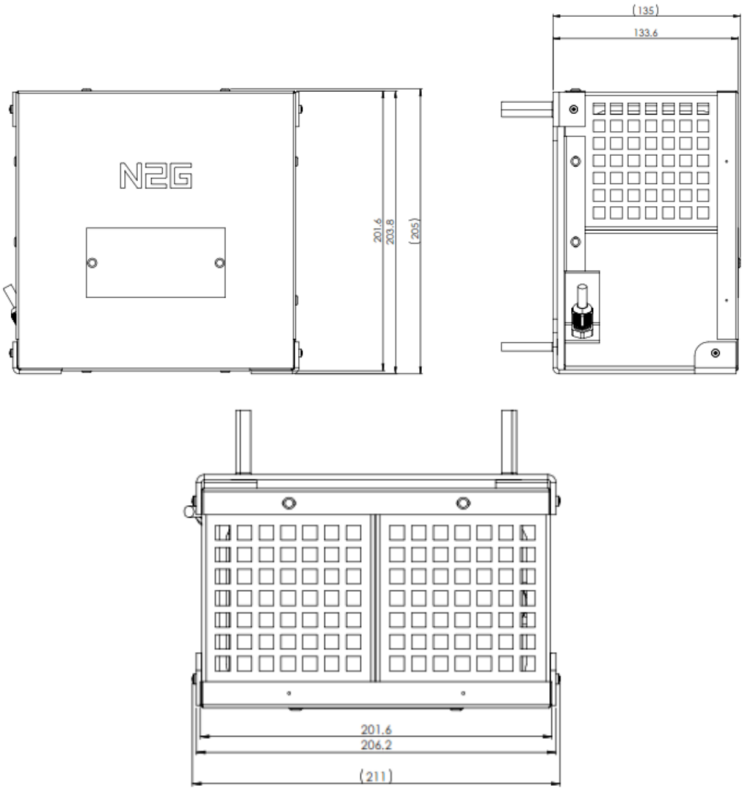

Annex A
for certificate of EU-type examination

Detailed identification of articles

Certificate No.: **PB 002532 001**

Test Report No.: **11002463 001**

Assessment Report No.: **11002463 001-A**

Generic type: **Gas generator**

Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**

Registration number: **2806 – P1 – 002532**

Manufacturer code .....: **N2G Type 2,5**

Name of product.....: **-**

Dimensions (mm)		Weight (g)		Sound level
Height :	190	NEC of initiator:	0,395	<120 dB AI MAX at 3 m
Width:	250,5	Fire-extinguishing tablet	2500	
Length:	195,1	Gross mass:	10300	

Other information.....:

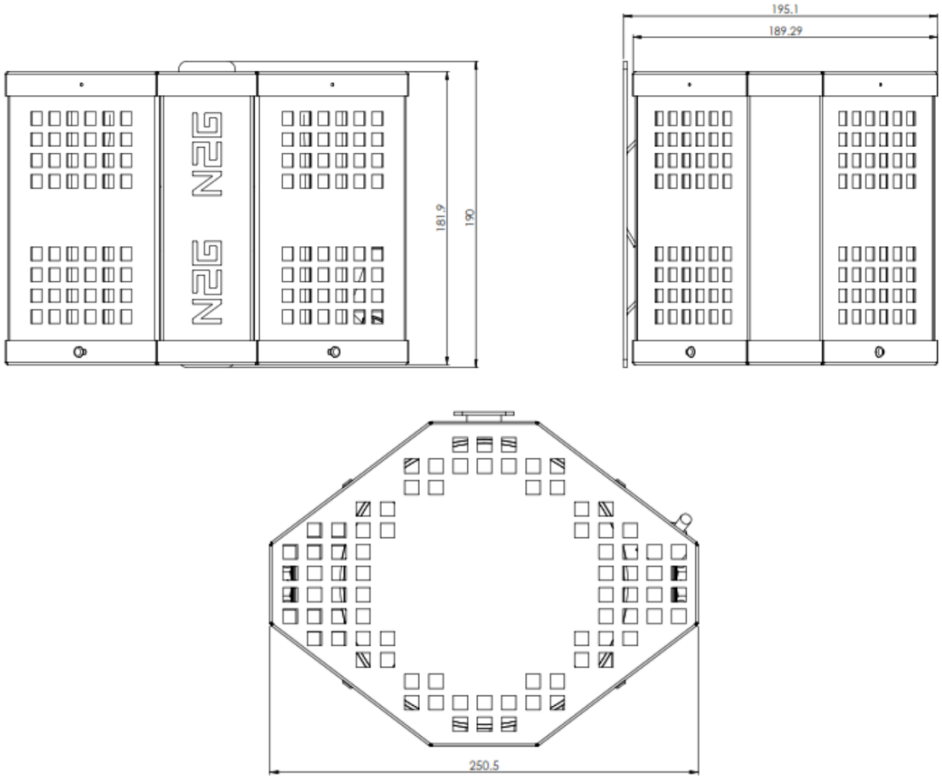

Annex A
for certificate of EU-type examination

Detailed identification of articles

Certificate No.: **PB 002532 001**

Test Report No.: **11002463 001** Assessment Report No.: **11002463 001-A**

Generic type: **Gas generator** Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**

Registration number: **2806 – P1 – 002532**

Manufacturer code .....: **N2G Type 5,0**

Name of product.....: **-**

Dimensions (mm)		Weight (g)		Sound level
Height :	233	NEC of initiator:	0,395	<120 dB AI MAX at 5 m
Width:	273	Fire-extinguishing tablet	5000	
Length:	434	Gross mass:	21700	

Other information.....:

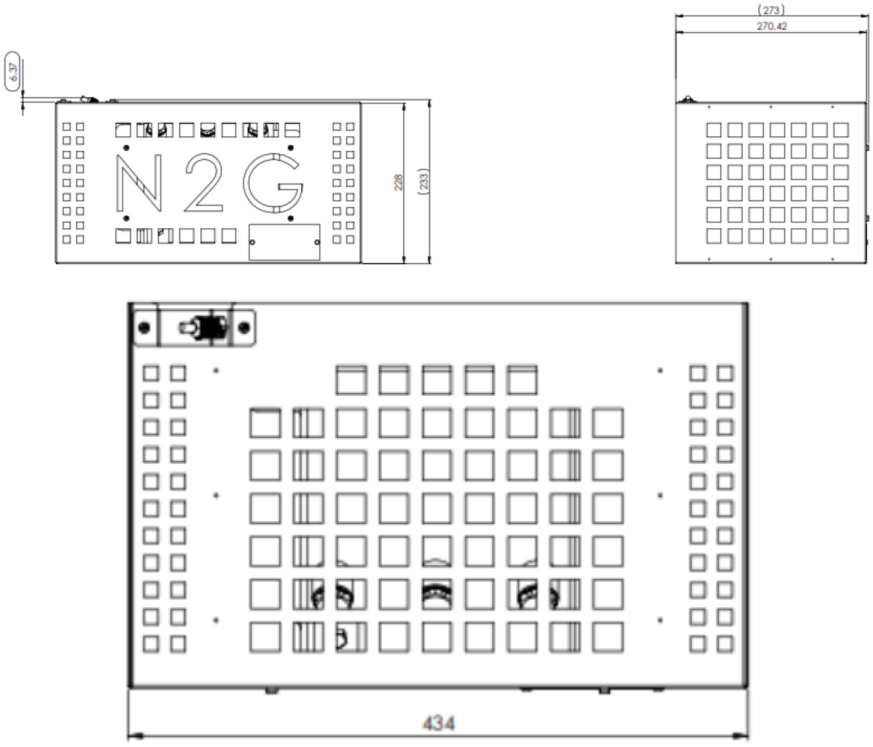

Annex A
for certificate of EU-type examination

Detailed identification of articles

Certificate No.: **PB 002532 001**

Test Report No.: **11002463 001** Assessment Report No.: **11002463 001-A**

Generic type: **Gas generator** Subtype: **Pyrotechnic fire-fighting device**

Category: **P1**

Registration number: **2806 – P1 – 002532**

Manufacturer code .....: **N2G Type 10,5**

Name of product.....: **-**

Dimensions (mm)		Weight (g)		Sound level
Height :	233	NEC of initiator:	0,395	<120 dB AI MAX at 5 m
Width:	273	Fire-extinguishing tablet	10500	
Length:	735,4	Gross mass:	36700	

Other information.....:

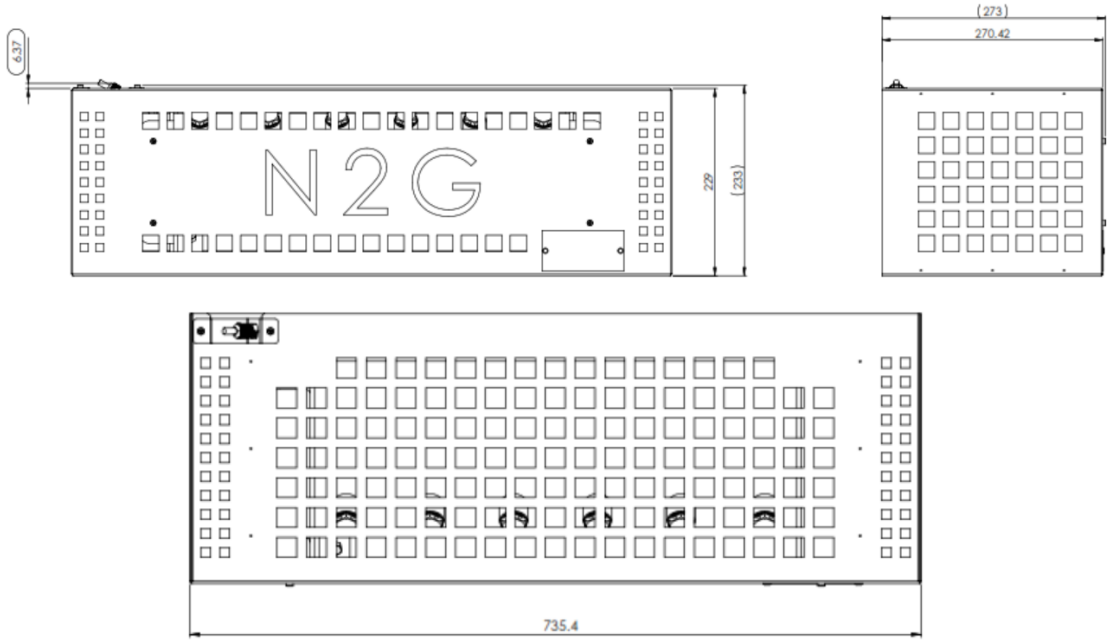

ANNEX B
for certificate of EU-type examination

Instruction for safe use, storage and disposal

Certificate No.: PB 002532 001

Generic type: Gas generator

Subtype: Pyrotechnic fire-fighting device

Category: P1

Registration number: 2806 – P1 – 002532

Code / Name given by the Manufacturer

N2G Type 0,5 /

N2G Type 1,0 /

N2G Type 1,5 /

N2G Type 2,5 /

N2G Type 5,0 /

N2G Type 10,5 /

Instruction of use: Article to be used in accordance with written instructions and national regulations.

Shelf-life: The expiration date specified by the manufacturer or importer.

Storage conditions: Must be protected from moisture, direct heat and impact.
In accordance with labelling and national legislation.

Instruction for disposal: In accordance with labelling and national legislation.